

In this back hallway there is a cold water pipe for an outside hose outlet. It needs to be turned off in drop ceiling and have the water blown out forcibly every fall. Otherwise it will freeze, if water is not **completely blown out**. The firemen should do this but may need some monitoring.

There is also heat tape in drop ceiling, on cold water pipe (nearby) that is fully automatic.


Wall packs on east side have motion sensors

Photocell under eave for most lights
need small ladder to tape off, keep PC pointed away from nearby fixture

RAB WP1 LED 30 WATT

RAB WP1 LED 30 WATT

PC

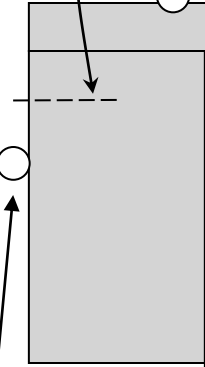

contactor by main restroom door, with photocell override switch inside j-box Circuit L1A-#9

Many items changed to LED ????

Station 10 outdoor light bulbs
12-22-20
←
NORTH

RAB WP1 LED 30 WATT

Flag pole light fed from a j-box in laundry rm

RAB WP1 LED 30 WATT

Some of these have tamper proof screws need 6' ladder

PC

RAB FF LED 18 WATT

RAB WP1 LED 30 WATT

Ballast bypassed for 16.5 watt LED type bulb med base, need bucket truck, unscrew 4 philips screws on top of fixture to release large dome down for access to bulb

RAB FF LED 18 WATT

